

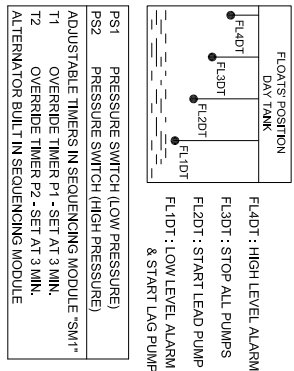


NOTE: : TERMINALS
 : TERMINALS ON ALARM RELAY SOCKET

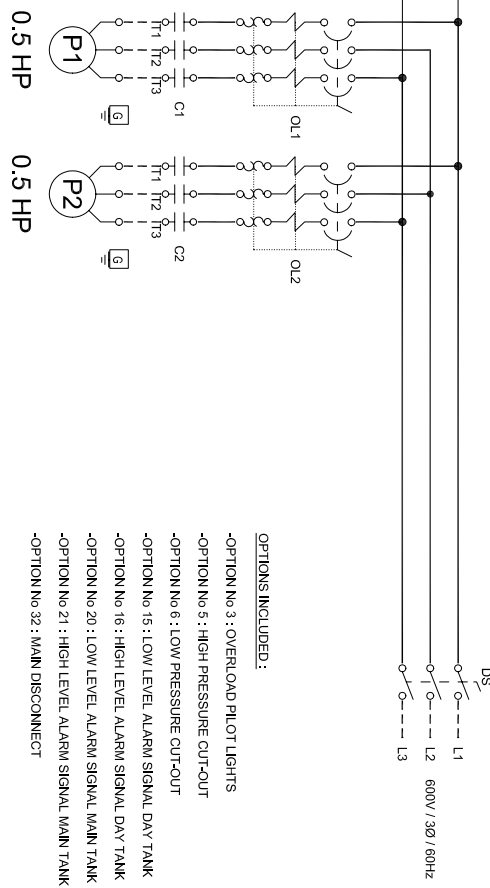

- OPTIONS INCLUDED:**
- OPTION No 3 : OVERLOAD PILOT LIGHTS
 - OPTION No 5 : HIGH PRESSURE CUT-OUT
 - OPTION No 6 : LOW PRESSURE CUT-OUT
 - OPTION No 15 : LOW LEVEL ALARM SIGNAL DAY TANK
 - OPTION No 16 : HIGH LEVEL ALARM SIGNAL DAY TANK
 - OPTION No 20 : LOW LEVEL ALARM SIGNAL MAIN TANK
 - OPTION No 21 : HIGH LEVEL ALARM SIGNAL MAIN TANK
 - OPTION No 32 : MAIN DISCONNECT

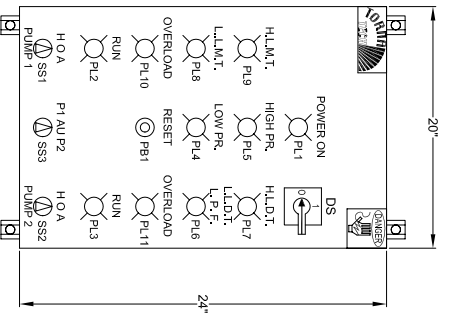

LAYOUT MAY VARY SLIGHTLY

PROJECT NAME : **DUPEX OIL PUMP CONTROLLER (TYPE ADA)**

DATE: 07/06/13
 LAST No. 38
 DRAWN: [Name]
 CHECKED: [Name]
 APPR: [Name]

CUSTOMER: **ALBANY PUMP CO. LTD**

REF. No. 07-5542

OPT No. 3, 5, 6, 15, 16, 20, 21, 32
 DRAWING No. **TQ-1817-S1/E**

07061302

