

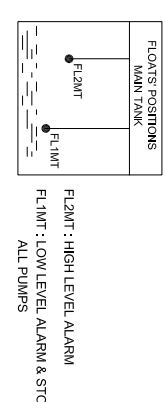
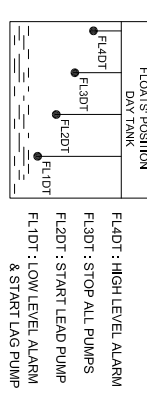


\* IF ONLY ONE POWER SUPPLY LINE  
JUMPER 1L1 & 2L1  
JUMPER N & N

- OPTIONS INCLUDED:
- OPTION No 3 : OVERLOAD PILOT LIGHTS
  - OPTION No 5 : HIGH PRESSURE CUT-OUT
  - OPTION No 6 : LOW PRESSURE CUT-OUT
  - OPTION No 15 : LOW LEVEL ALARM SIGNAL DAY TANK
  - OPTION No 16 : HIGH LEVEL ALARM SIGNAL DAY TANK
  - OPTION No 20 : LOW LEVEL ALARM SIGNAL MAIN TANK
  - OPTION No 21 : HIGH LEVEL ALARM SIGNAL MAIN TANK
  - OPTION No 23 : KEY LOCK CW 2 KEYS

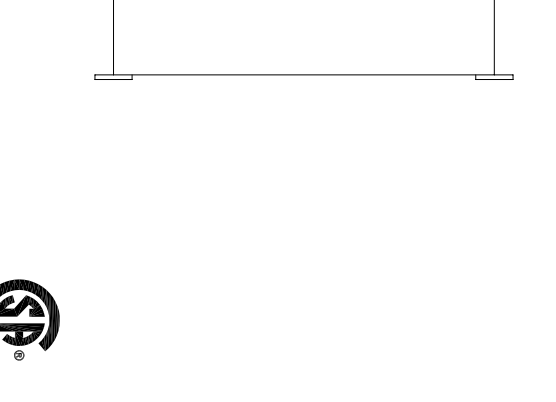

- PS1 PRESSURE SWITCH (LOW PRESSURE)
- PS2 PRESSURE SWITCH (HIGH PRESSURE)
- ADJUSTABLE TIMERS IN SEQUENCING MODULE "SM1"
- T1 OVERRIDE TIMER P1 - SET AT 3 MIN.
- T2 OVERRIDE TIMER P2 - SET AT 3 MIN.
- ALTERNATOR BUILT IN SEQUENCING MODULE

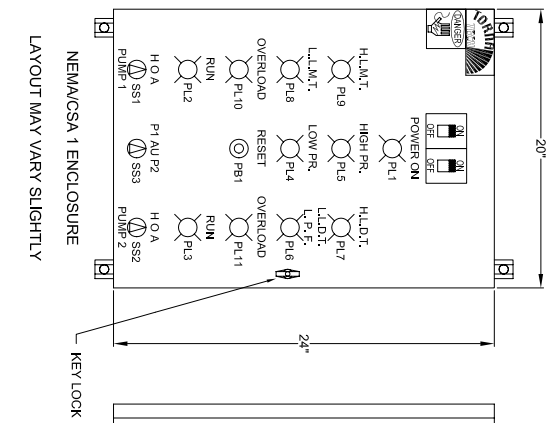

PROJECT NAME :  
**DUPELEX OIL PUMP CONTROLLER (TYPE ADA)**

DATE	07/06/01	PROJECT NAME	DUPELEX OIL PUMP CONTROLLER (TYPE ADA)
DRAWN	38	ORDER NO.	07-5491
CHECKED		REF. No.	07-5491
CUSTOMER	ALBANY PUMP CO. LTD	DRAWING No.	TQ-1661-S1/E
APPR.			

07060102

